


G:\ENGINEERING&OPERATION\ENGINEER DRAWINGS\PowerDwgs\WorkOrder\L-Construction Standard\Material & Inst Criteria UG Elect System\1L535.dwg

REV	DESCRIPTION	BY	DATE
1	CHANGED CO. NAME	T.N.	11/20/09
2	CHANGED REF. LINE FOR TO CLEARANCE	L.S.	6/06/12
3	NEW CLEARANCES	J.U.	6/3/15
4	CORNER TWO DIAGRAM DIMENTION REMOVE	J.U.	7/21/15
5	CLEARANCES TO MATCH PG&E STANDARDS	A.A.	5/25/18
6	CLEARANCES TO MATCH PG&E STANDARDS	P.G.	04/17/24

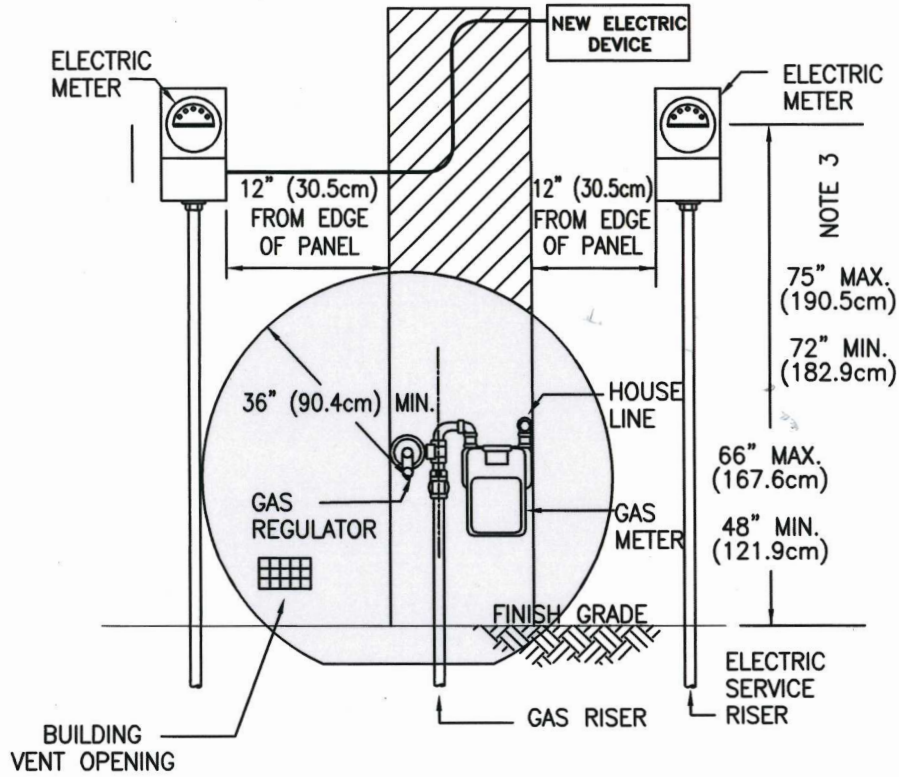

REQUIRED MINIMUM SEPARATIONS AND CLEARANCES BETWEEN ELECTRICAL AND GAS METERS

NOTES:

1. ELECTRIC METER PANEL LOCATIONS ARE SUBJECT TO ALAMEDA MUNICIPAL POWER (AMP) APPROVAL AND MUST COMPLY WITH THE ALAMEDA ELECTRICAL CODE REQUIREMENTS.
2. GAS METER LOCATIONS ARE SUBJECT TO GAS UTILITY'S APPROVAL.
3. INDIVIDUAL ELECTRIC METER WHEN INSTALLED NEAR A DRIVEWAY.

LEGEND:

- NO EXISTING ELECTRIC METER/PANEL AND NO NEW ELECTRIC DEVICES
- NO ELECTRICAL, NO CONDUIT, NO SOURCE OF IGNITION, NO METER/PANEL, AND NO NEWGROUNDING WIRES OR CLAMPS
- REGULATOR VENT OPENING
- CONDUIT

ALAMEDA MUNICIPAL POWER
 A Department of the City of Alameda
 2000 GRAND STREET, P.O. BOX H
 ALAMEDA, CALIFORNIA 94501

TITLE : **REQUIRED MINIMUM SEPARATIONS AND CLEARANCES BETWEEN ELECTRICAL AND GAS METERS**

DRAWN :	P. GIRMA	DATE: APRIL 17, 2024	DWG. NO.:	REV.
REVIEWED:	<i>[Signature]</i>		1-L-535	6
APPROVED:	<i>[Signature]</i>		SCALE: NTS	SHT 1 OF 1